


FIRE HYDRANTS SHALL BE  
SET A MINIMUM OF 6' FROM  
ALL DRIVEWAY OPENINGS

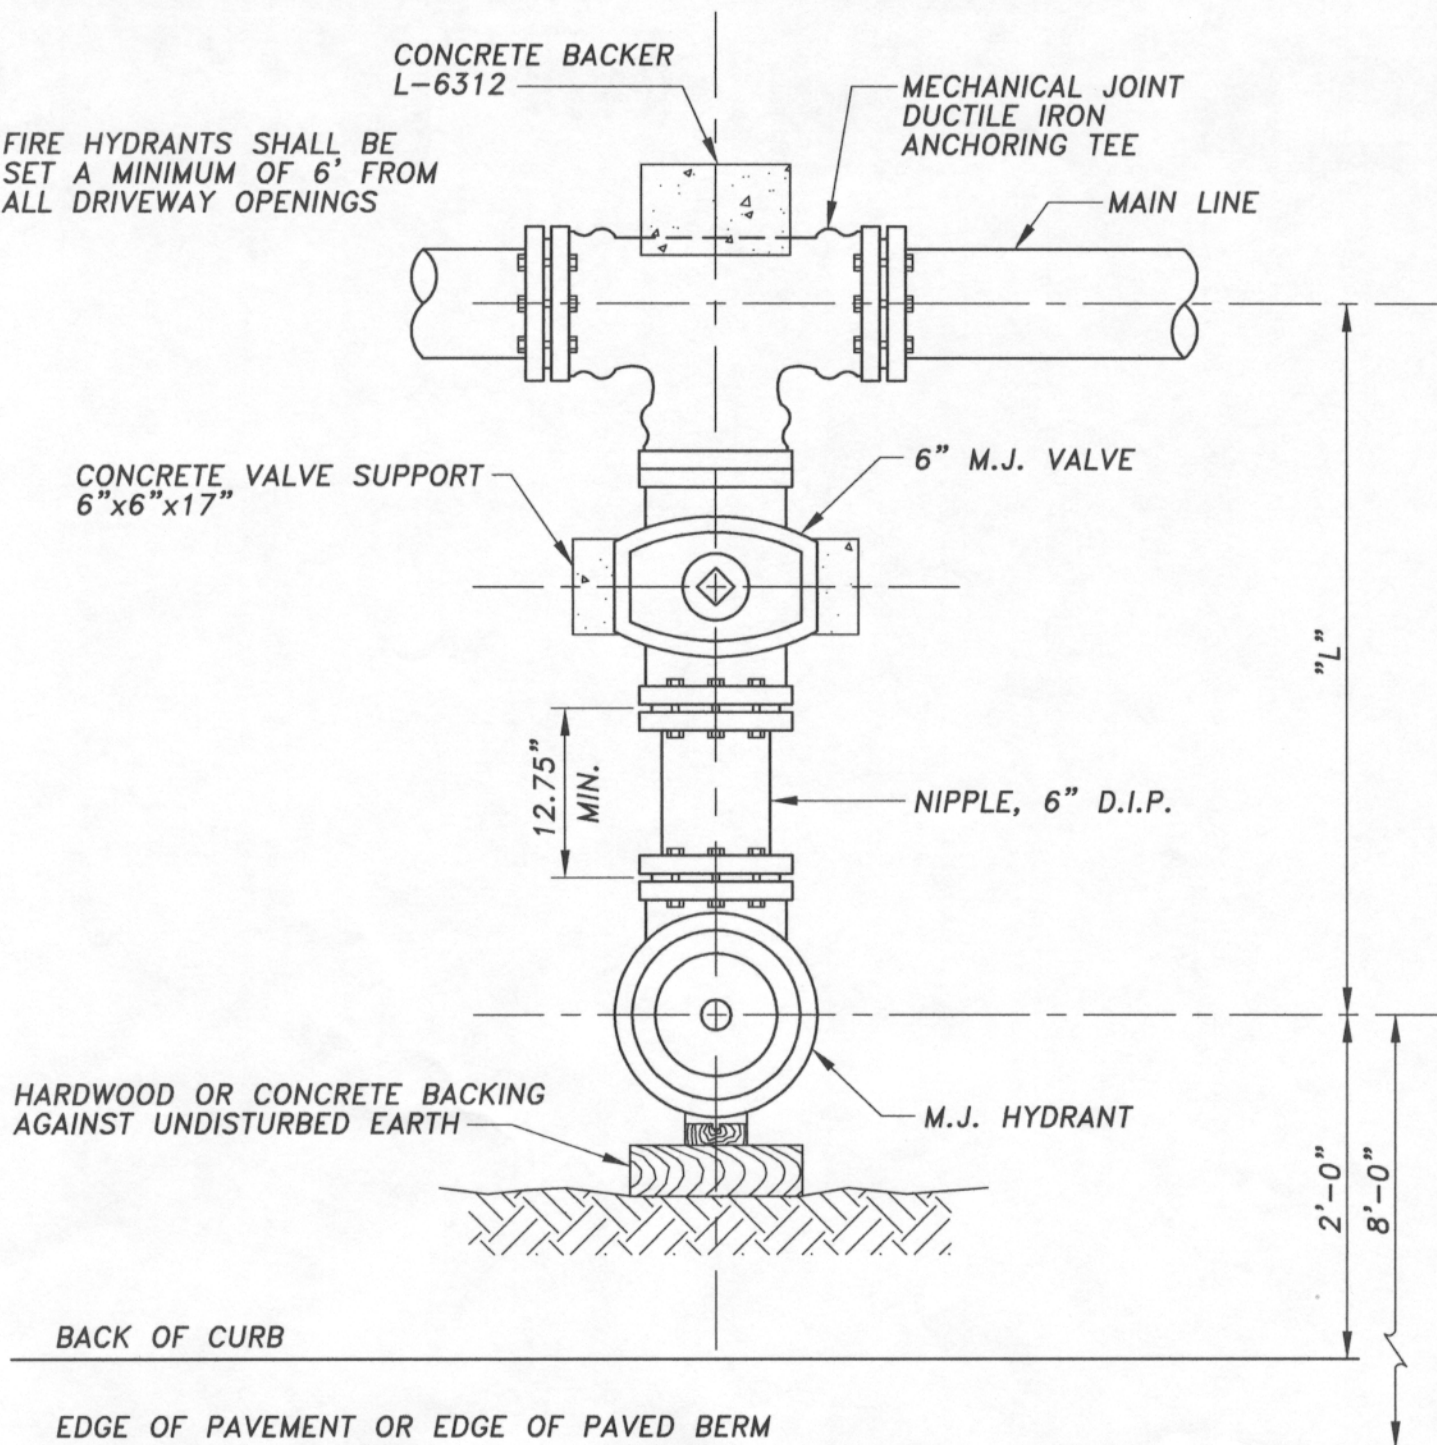

MAIN LINE	DIMENSION "L"
	TYPE "A"
6"	35"
8"	36"
12"	39"
16"	42"

**NOTE:**

FIRE HYDRANT SHALL HAVE A MAXIMUM BURY  
OF 7'-0". MODIFICATION OF THE HYDRANT  
LEAD TO MEET THIS REQUIREMENT SHALL BE  
IN THAT SECTION FROM THE VALVE TO THE  
HYDRANT AS PER STANDARD DETAIL L-7601.

CITY OF COLUMBUS  
DEPARTMENT OF PUBLIC UTILITIES  
DIVISION OF WATER

APPROVED:

ENGINEER

11/30/01  
DATE

STANDARD DETAIL  
**TYPICAL HYDRANT SETTING**  
TYPE "A"

L-6637